


UPRIGHT CABINET

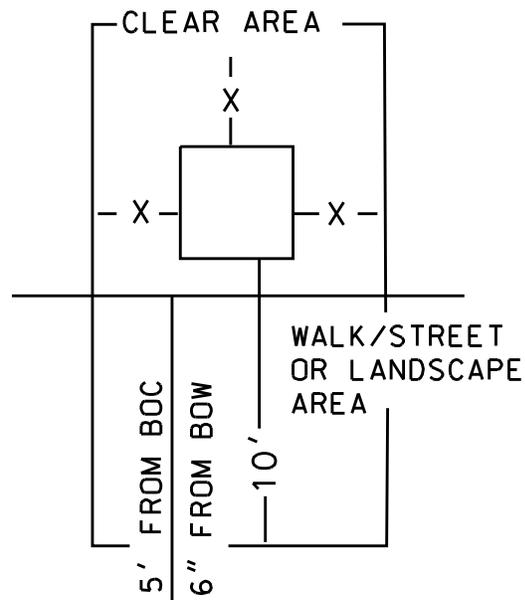

TRANSFORMER

CLEARANCES "X"

- 3' FROM LANDSCAPE MATERIAL
- 3' MINIMUM FROM STRUCTURES
- 3' ADJACENT TO RESIDENTIAL DRIVEWAYS
- 3' MINIMUM FROM A DRIVING SURFACE WITH THE USE OF BOLLARDS
- 5' FROM A DRIVING SURFACE BEHIND A CURB OR PROTECTIVE FEATURE
- 10' FROM A DRIVING SURFACE WHERE NO PROTECTIVE FEATURE IS PROPOSED

1. MAINTAIN MINIMUM CLEARANCES AS NOTED ABOVE
2. BOLLARDS WILL BE INSTALLED AT THE DEVELOPER/OWNER'S EXPENSE WHEN EQUIPMENT IS NOT PROTECTED FROM VEHICULAR TRAFFIC
3. TRANSFORMER LOCATIONS SHALL BE ESTABLISHED BY THE OWNER TO MEET LPC'S MINIMUM CLEARANCES AND ALL FIRE CLEARANCES REQUIRED BY APPLICABLE CODES
4. SOD IN CLEAR AREAS.

	<b>CLEARANCES</b>		
	REV. 1	700-02B	SCALE: NA
POWER & COMMUNICATIONS	DATE: 10/06	DRAWN BY: RAWTMF	APPROVAL: